
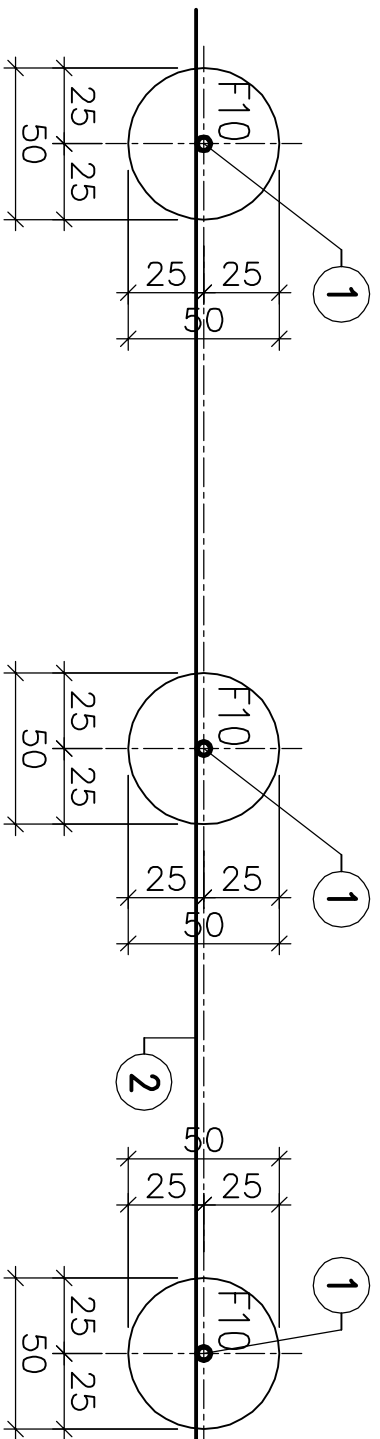


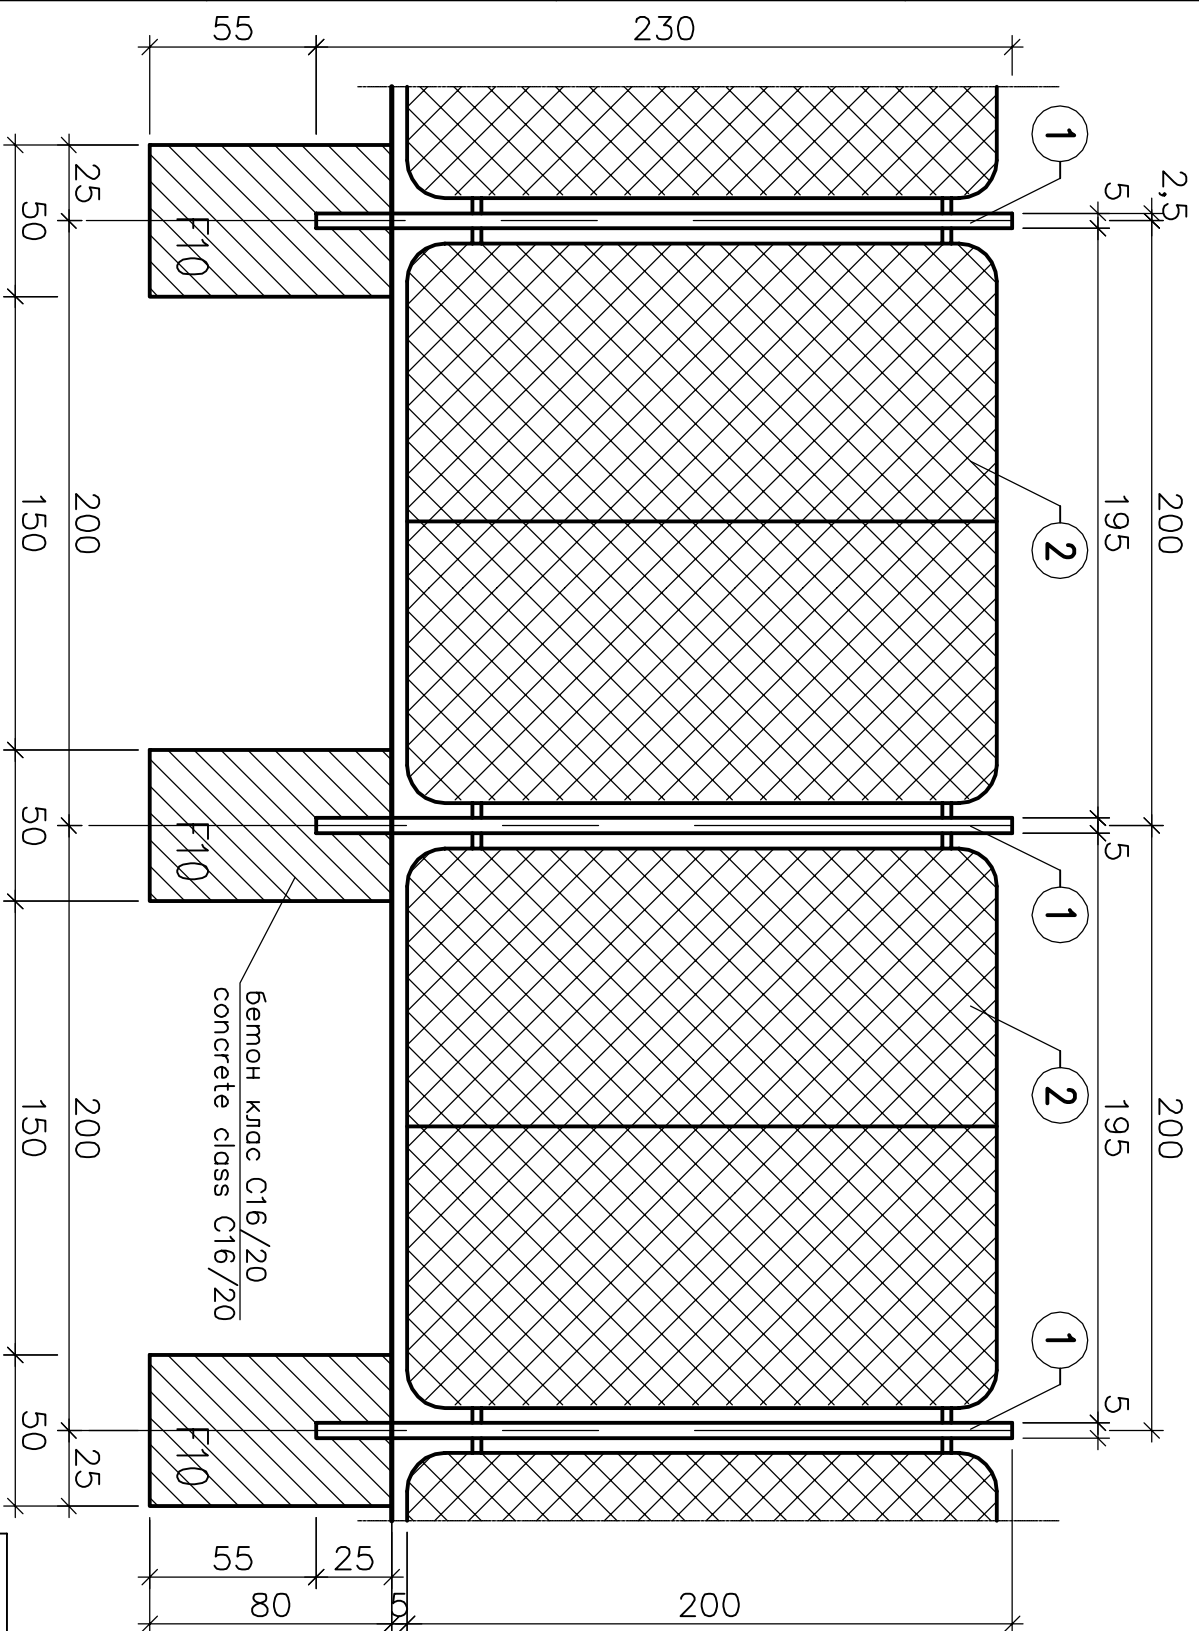

СЫҒЛАСУВАЛЫ		
Част	Име	Портис
Технологияна (Пайдалану комутация)	инж. Понгваков	
Технологияна (Вторична комутация)	инж. Гальбова	
Технология	инж. Божинков	
ПБЗ	инж. Тодорова	
Пожарно безопасност	инж. Тодорова	
Възложител		

1. Galvanic separation to internal from the existing exterior fence, look in the "Primary switching"
2. After construction of the new part of the inner fence, tracery and part should be treated with durable corrosion-resistant coating proper for operational environment C3 and serface life M according to the standard ISO 12944.

Notes:

1. Галваничното отделение на вътрешната от съществувашата външна ограда, вж в част "Първична комуникация"
2. Следи изграждането на новата част от вътрешната ограда, ажура на и част да се подготви и обработи с трийно антикорозионно покритие за експлоатационна среда С3 и експлоатационна влажност М съгласно стандарт ISO 129

Забелешку:

- Бетон : клас C16/20 – $5 \times 0.16 = 0.8 \text{ m}^3$
- ① Стоманена тръба $\varnothing 50/5$: $5 \times 2.3 \times 5.5 = 64 \text{ kg}$
- ② Съществувачи панел от гевмонпанела ограда
- Specification of materials:**
- Concrete : class C16/20 – $5 \times 0.16 = 0.8 \text{ m}^3$
- ① Steel pipe $\varnothing 50/5$: $5 \times 2.3 \times 5.5 = 64 \text{ kg}$
- ② Dismantled panels of the existing fence

Спецификация на материалите:

This image contains technical drawings and project information for a fence construction project.

The top section shows two views of the fence: a plan view (top) and a side elevation view (bottom). The plan view shows three sections of the fence, each 200 units long, separated by 5-unit gaps. The total length is 605 units. The side elevation view shows the fence profile with dimensions: height 230 units, base width 55 units, and concrete foundation width 80 units. It also indicates the concrete class C16/20.

The middle section contains a list of materials and specifications:

- Бетон : клас C16/20 – 5x0.16=0.8m³
- Стоманена тръба Ø50/5 : 5x2.3x5.55=64kg
- Съществувачи панел от гевмантираната ограда

The bottom section contains a table with project details:

Customer: "ЕВН България Електропреносно-дистрибуция" ЕАД		Project Manager: -	
Contract No.: 4028/2012		Section: A3 Part: 1	
Object: Подстанция 110/20kV "Лютин", гр. Любимец		Date: 05.2019	
Subject: New outgoing feeder 110kV		Designer: Koteva	
		Approved: Todorova	
		Format: A3	
		Phase: detailed design	
		Part: Civil work	
		Sheet: 1	
Notes: - Galvanic separation to internal from the existing exterior fence, look in the "Primary switching" - After construction of the new part of the inner fence, tracer and part should be treated with durable corrosion-resistant coating proper for operational environment C3 and surface life M according to the standard ISO 12944.		СЪГЛАСУВАЛИ Име: _____ Подпис: _____	
Забележки: - Галваничното отгелване на вътрешната от съществуващата външна ограда, виж в част "Първична комутация" - След изграждането на новата част от вътрешната ограда, ажурната и част да се погрозят и обработят с трайно антикорозионно покритие за експлоатационна среда С3 и експлоатационна дълготрайност М съгласно стандарт ISO 12944.		Име: _____ Подпис: _____	